



Legacy Manuals


Description

Legacy Manuals

Nimbus Blower Speed Controller



Control Via	DIP switch	
	7	8
Current or Voltage	ON	OFF
Remote Powered Transducer	OFF	ON
Temperature	OFF	OFF
Fixed Speed	ON	ON

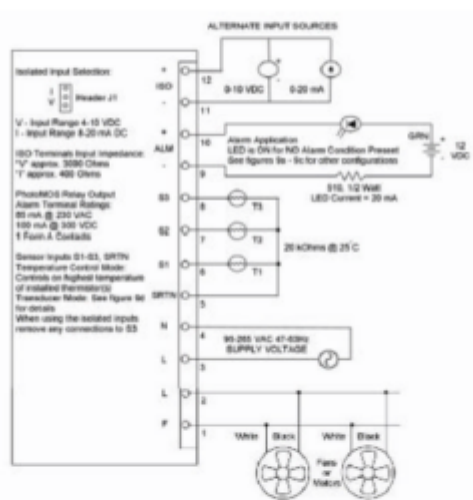

[Nimbus Blower Speed Controller](#)




Seresco: (pronounced Sir-ES-co) Meaning, "to become dry"

Installation and Operation Manual

NE Series Dehumidifiers

For Models:
PV, NV, PH and NH Configuration Natatorium Dehumidifiers
INC Series Outdoor Air-cooled Condensers

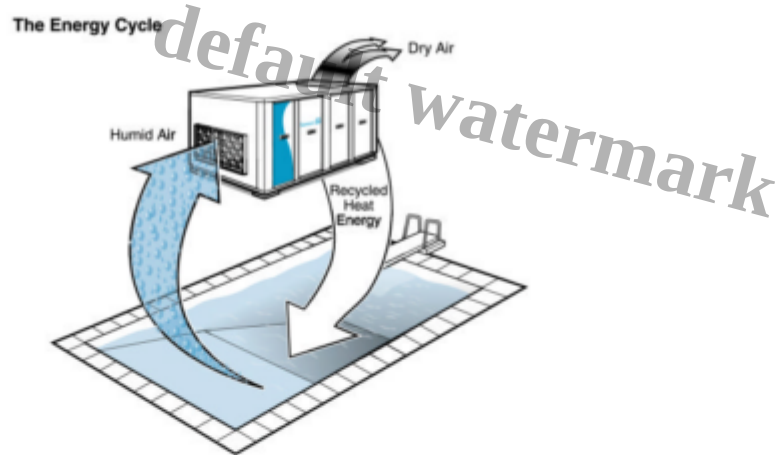

1

[O&M Basic for Large Units \(2008\)](#)



Seresco: (pronounced Sir-ES-co) Meaning, "to become dry"

Installation and Operation Manual

NE Series Dehumidifiers

For Models:
PV, NV, PH and NH Configuration Natatorium Dehumidifiers
INC Series Outdoor Air-cooled Condensers

[O&M for Seresco Large Units Gas March 2008](#)




Seresco: (pronounced Sir-ES-co) Meaning, "to become dry"

Installation and Operation Manual

NE Series Dehumidifiers

For Models:
PV, NV, PH and NH Configuration Natatorium Dehumidifiers
INC Series Outdoor Air-cooled Condensers

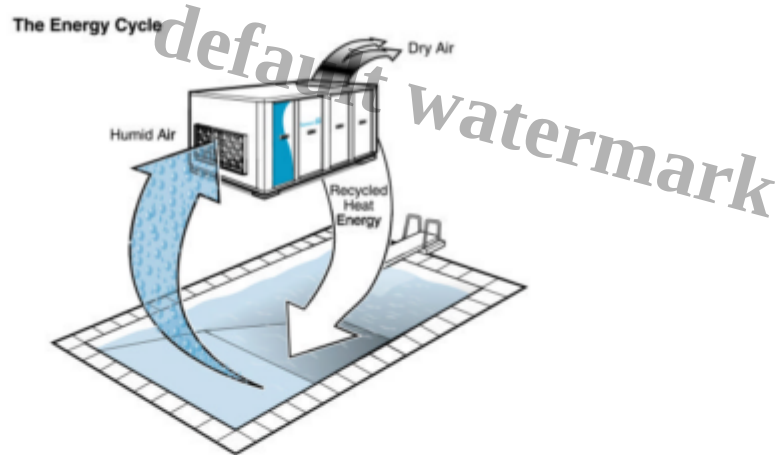

1

[O&M for Seresco Large Units HW March 2008](#)



**NE Series – Compact Outdoor
Dehumidifiers**

Seresco NE Series Compact Outdoor September 2020



NG Series Dry Coolers

Operation and Maintenance Manual

Seresco

SerescoDehumidifiers.com

Seresco NG Series Dry Cooler

Your local Seresco representative:

Heat Recover (Run Around Loop)

The energy a room loses from the exhaust air, as a result of the fresh air requirements, can represent approximately 50 % of the room heating requirements. The Seresco unit captures 50-60 % of this exhaust heat with its heat recovery loop. By doing so it supplies heat to warm the cold OA and can provide generous energy savings to the room and reduce heating costs. During freezing weather conditions the OA can provide much of the dehumidification required and minimizing the time the compressors run offsetting some of the running electrical costs.

Our typical energy recovery loop places two glycol coils one in the outside air intake and the other in the exhaust air-stream. The coils are connected in counter-flow closed loop piping system. The system comprises an inline fluid cooled pump, an air separator, and in some larger systems a pressure tank and pressure gauge. By circulating a glycol mixture, typical 30%, we can extract enough heat from exhaust air stream to preheat the outside air intake to about 50-60% of the room temperature. Extracting more heat from the exhaust air stream is possible but would also lead to possibly freezing of the exhaust air and would require a more complex and costly system of frost prevention. Keeping our effectiveness down to 50-60% reduces initial cost and keeps things simple.



[O&M HR and Glycol Pump](#)



[Seresco: (pronounced sir-s-ko) meaning "to become dry"]

Installation, Operation and Maintenance Manual

OA Series Dehumidifiers

Models: OA-016 to 024-NH/V/M/N-I



Rev 0910.1

[OA Manual](#)



NP Series Dehumidifiers

[Seresco NP Series OMM September 2020](#)



**NV Series
Dehumidifiers**

Operation and Maintenance Manual

Seresco

SerescoDehumidifiers.com

[Seresco NV Series OMM September 2020](#)



**NE Series – Classic Indoor
Dehumidifiers**

[Seresco NE Series Classic Indoor September 2020](#)



**NE Series – Compact Indoor
Dehumidifiers**

Operation and Maintenance Manual

default watermark

Seresco

SerescoDehumidifiers.com

[Seresco NE Series Compact Indoor September 2020](#)



[Seresco Dehumidifiers Installation Manual \(January 2022\)](#)



CWT SER DEHUMI

[Seresco CWT Series OMM \(May 2022\)](#)



NE SERIES DEHUMIDIFIERS

OPERATIONS AND MAINTENANCE MANUAL

[Seresco NE Series Classic Indoor \(May 2022\)](#)



NE SERIES DEHUMIDIFIERS

OPERATIONS AND MAINTENANCE MANUAL

[Seresco NE Series Compact Indoor OMM \(May 2022\)](#)



NE SERIES DEHUMIDIFIERS

OPERATIONS AND MAINTENANCE MANUAL

[Seresco NE Series Compact Outdoor OMM \(May 2022\)](#)



NP SERIES DEHUMIDIFIERS

[Seresco NP Series OMM \(May 2022\)](#)

default watermark